


MINI-THERM® JV

Hydronic Boilers

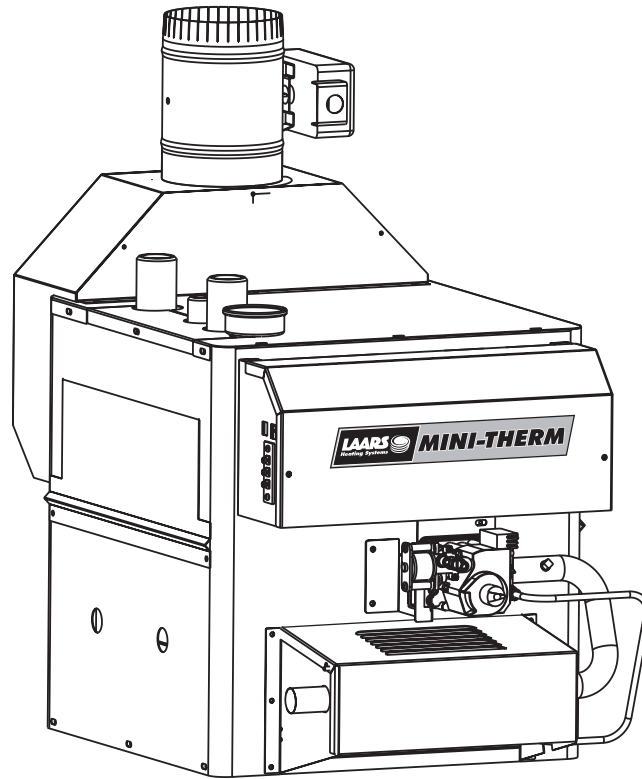

JV Residential Gas-Fired Boiler

Indoor Sizes 50-225 MBTU/h

Submittal Data **LAARS** Heating Systems

Standard Equipment


- Venting: built-in draft diverter
- Design certified/tested by CSA International
- Natural or propane gas
- Maximum working pressure: water 30 P.S.I., ASME rated
- Hydrostatic test pressure at factory: 60 P.S.I.
- Maximum gas supply pressure: Natural 10.5" W.C.; Propane 13" W.C.
- Pressure relief valve: capacity in excess of boiler input rating
- Material specifications per Section IV, ASME Code
- Headers: cast iron per ASME requirements
- Tubes: pure copper with integral formed external fins
- Main burners: aluminized steel
- Air supply: natural aspiration
- Altitudes: 0 - 10,000 ft.
- Floor under boiler: when used on combustible floor, a special base must be supplied (see installation instructions, Document 1025 & rating plate)
- Two-stage combustion system and operating controls (JVS sizes 100-225)
- Electrical: 115V-60Hz-1PH less than 12 amperes 24V transformer mounted and wired
- Pump relay: standard
- Vent damper and wire harness
- Blocked vent safety switch (B.V.S.S.)
- Rollout safety switch
- Up to 84% Thermal efficiencies @ high fire
- 20 Year Limited Warranty

Minimum Clearances from Adjacent Construction

Minimum Clearances, inches *cm*

Size	Left + Right Sides, Rear		Front		Flue		Top	
50	6	15	4	10	6	15	23	58
75	6	15	4	10	6	15	23	58
100	6	15	4	10	6	15	23	58
125	6	15	4	10	6	15	23	58
160	6	15	4	10	6	15	36	91
225	6	15	4	10	6	15	36	91

Dimensional Data

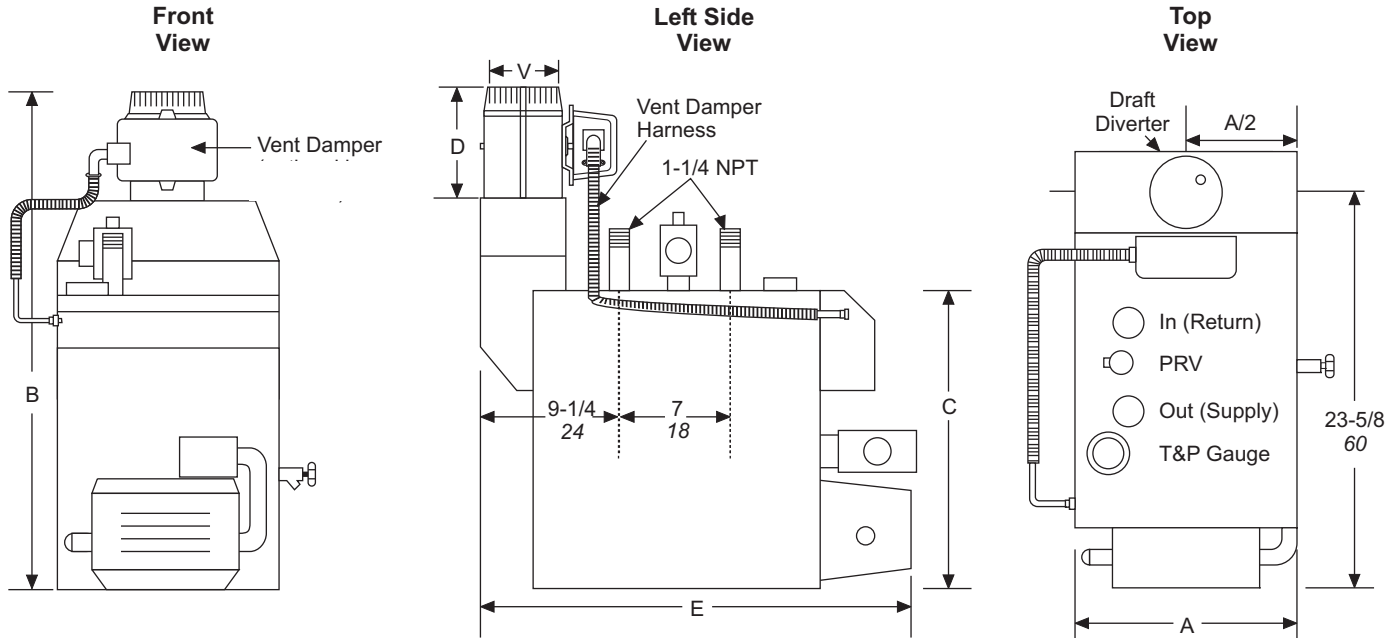

Size	Dimensions inches <i>cm</i>						Approx Weight	
	A	B	C	D	E	V	lbs.	kg
50	13-3/8 34	27-3/4 71	18 46	21-3/4 55	26-1/2 67	4 10	120	54
75	13-3/8 34	27-3/4 71	18 46	21-3/4 55	27-1/2 70	5 13	126	57
100	16-7/8 43	28-3/4 73	18 46	22-3/4 58	27-1/2 70	5 13	134	61
125	16-7/8 43	28-3/4 73	18 46	22-3/4 58	27-1/2 70	6 15	138	63
160	20-3/8 52	28-3/4 73	18 46	22-3/4 58	27-1/2 70	6 15	164	74
225	25-5/8 65	31-1/2 80	20 51	24-3/4 63	27-1/2 70	7 18	181	82

JV Size	Input		JVS Firing Mode	JVT Firing Mode	Heating Capacity		Net IBR		AFUE %		Water Conn. in.	Gas Conn. in.
	MBTU/h	kW			MBTU/h	kW	MBTU/h	kW	JVS Spark	JVT Std.		
50	50	14.6	On/Off	On/Off	42	12.3	36.5	10.7	84.4	80.2	1-1/4	1/2
75	75	21.9	On/Off	On/Off	63	18.5	54.8	16.1	84.0	80.5	1-1/4	1/2
100	100	29.1	2-Stage	On/Off	84	24.6	73	21.4	82.0	80.7	1-1/4	1/2
125	125	36.6	2-Stage	On/Off	105	30.8	91.3	26.8	81.9	80.7	1-1/4	1/2
160	160	46.8	2-Stage	On/Off	134	39.3	116.9	34.3	80.2	81.0	1-1/4	1/2
225	225	65.9	2-Stage	On/Off	189	55.4	164.3	48.1	81.8	81.5	1-1/4	1/2



Waterpik Technologies
 6000 Condor Drive, Moorpark, CA 93021 • 805.529.2000 • FAX 805.529.5934
 20 Industrial Way, Rochester, NH 03867 • 603.335.6300 • FAX 603.335.3355
 480 S. Service Road West, Oakville, Ontario, Canada L6K 2H4 • 905.844.8233 • FAX 905.844.2635
www.laars.com